

RIA-AI-02

RS3™ - Interface Adapter for migration toward a new system

Description:

The RS3 Interface Adapter **RIA-AI-02-1** allows to easily connect an existing 16-channels Analog Input RS3 Termination Panel to two 8 channel Analog Input card of a Digital Control System (DCS), or a Programmable Logic Controller (PLC).

The signals coming from the RS3 Termination Panel are 4-20mA.

It is easy to install the **RIA-AI-02-1** on the existing RS3 termination panel.

It replaces the Field Interface Module (FIM) on the existing panel.

The connection to the new Analog Input cards is done using two shielded cables, with a D-SUB25F connector at one end, and labelled flying wires or a suitable connector matching with the new system 8 channel Analog Input card used at the other end.

The power supply of the existing RS3 Termination panel is no longer necessary for the power supply of the RIA.



Option -1: RIA-AI-02-1



Technical specifications:

Dimensions:

Length: 446,2 mm Width: 34 mm

Height: 93 mm



Weight:

400 g

Temperature range:

Operating : 0°C to 50°C Storage : -20°C to 60°C

Humidity:

Up to 90% (no condensation)

Mounting:

Plugged on the existing RS3 panel in place of the FIM module

Channel characteristics:

Loop Power supply: +24Vdc provided by DCS or PLC Power Supply, with channel-by-channel current limitation of the DCS or

PLC Input card (refer to the input card specifications)

Channel configuration:

Selection of "2 wire" or "4 wire" transmitter is done using internal jumpers (see RIA installation procedure within next pages.)

Fuse protection:

Each input is protected by a 100mA removable fuse

Connection to the DCS or to the PLC:

To an Analog Input Card:


By two D-Sub 25 pin male connector with UNC 4-40 female lock on front face of the RIA and two shielded suitable cables







1. <u>INSTALLATION PROCEDURE FOR EXISTING RS3 PANEL TYPE 1984-4383-0001 OR 10P54770001(CE) OR 10P54770002(CE) (MAIO (16) TERMINATION PANEL) :</u>

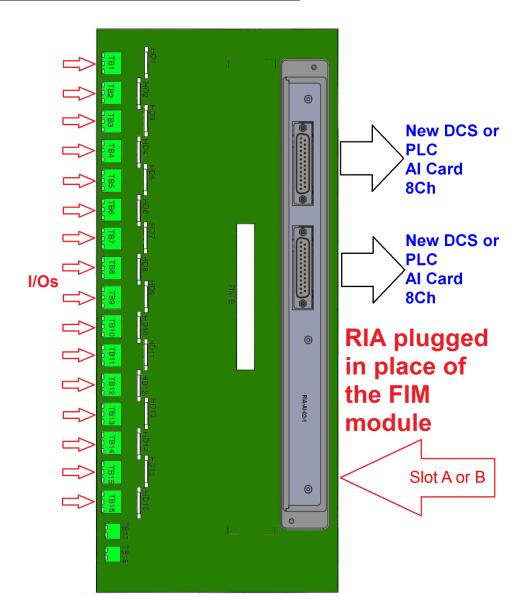

1.1. POWER SUPPLY CONNECTORS, TERMINALS AND JUMPERS

Connector J974: Can remain plugged but no longer necessary for panel power supply.

<u>Terminals TBA</u>: Can remain wired but no longer necessary for panel power supply.

Terminals TB17: Can remain wired but no longer necessary for panel power supply.

Terminals TB18 (SH - CH): No change of the existing wiring, jumper has to remain in place.

Terminals TB19 - TB20 - TB21 - TB22 : Remove all jumpers







1.2. LPM (LOOP POWER MODULE(S))


Remove LPM from its/their connector(s).

1.3. FIM MODULE(S)

Remove FIM modules from its/their connector(s)

1.4. JUMPER CONFIGURATION ON THE TERMINATION PANEL

Jumpers on the panel have to be configured as follow: HD1 to HD16 placed in "Full Left Position" corresponding to the "Self-Power Input Point" of the RS3 documentation.

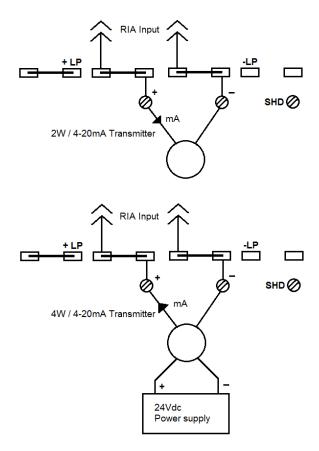

1.5. RIA CONFIGURATION

- Open RIA using screws
- Set jumpers on "Self-Position" for "4 wire" transmitter and on "System Position" for "2 wire" transmitter as
 indicated on the product, in accordance with the type (2 or 4 wire) of existing transmitters connected on the
 panel.

1.6. RIA INSTALLATION AND CONNECTION


- Unplug the Field Interface Module (FIM) from its/their socket(s) using front screws
- Plug the RIA either on connector J593 or J594 and secure it using its two screws
- Plug the D-SUB25 female connectors of the cables on the front D-SUB25 male connectors of the RIA.
- Connect the other end of the cables to the DCS or PLC 8 channel Al cards.







2. <u>INSTALLATION PROCEDURE FOR EXISTING RS3 PANEL TYPE 10P5034000X (MAIO16 IS TERMINATION PANEL)</u>:

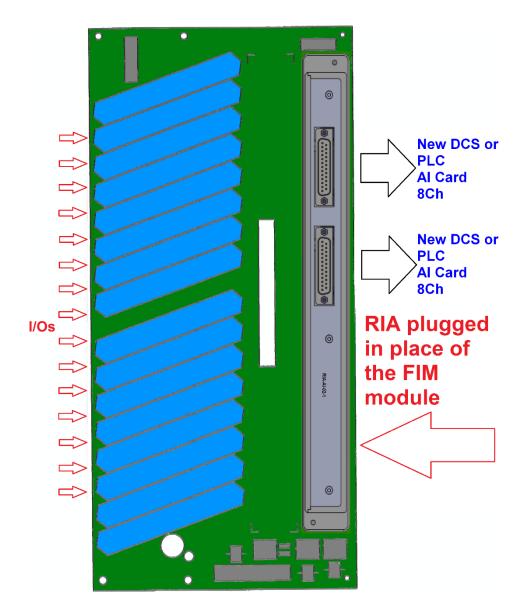

2.1. POWER SUPPLY OF THE PANEL

Power supply connected on terminals TBA of the panel has to be kept.

2.2. FIM MODULE(S)

Remove FIM modules from its/their connector(s)







2.3. JUMPER CONFIGURATION ON THE TERMINATION PANEL

No jumper configuration is required on the panel

2.4. RIA CONFIGURATION

- Open RIA adapter by unscrewing the screws from the case.
- Set all jumpers on "Self-Position" for "4 wire" transmitter as indicated on the product.

2.5. RIA INSTALLATION AND CONNECTION

- Unplug the Field Interface Module (FIM) from its/their socket(s) using front screws
- Plug the RIA either on connector J639 or J640
- Plug the D-SUB25 female connectors of the cables on the front D-SUB25 male connectors of the RIA.
- Connect the other end of the cables to the DCS or PLC 8 channel Al cards.



